
MATCHLINE
MATCHLINE

Landreth Lighting Luminaire Schedule									
Symbol	[MANUFAC]	Qty	Label	Arrangement	Description	LLF	Lum. Watts	Lum. Lumens	BUG Rating
	Stemberg Lighting	37	NEW	Single	SSP20777-PT-E350LED-UF-16L27T3-MDL018-SV2-R7/8213FP6- 250-EB-1.0-GFI LP/UC-WHK-DBA-CSTM-2-PA478PM-DIS-LP/UC-CLITT	0.900	32.7	5485	B2-U0-G1

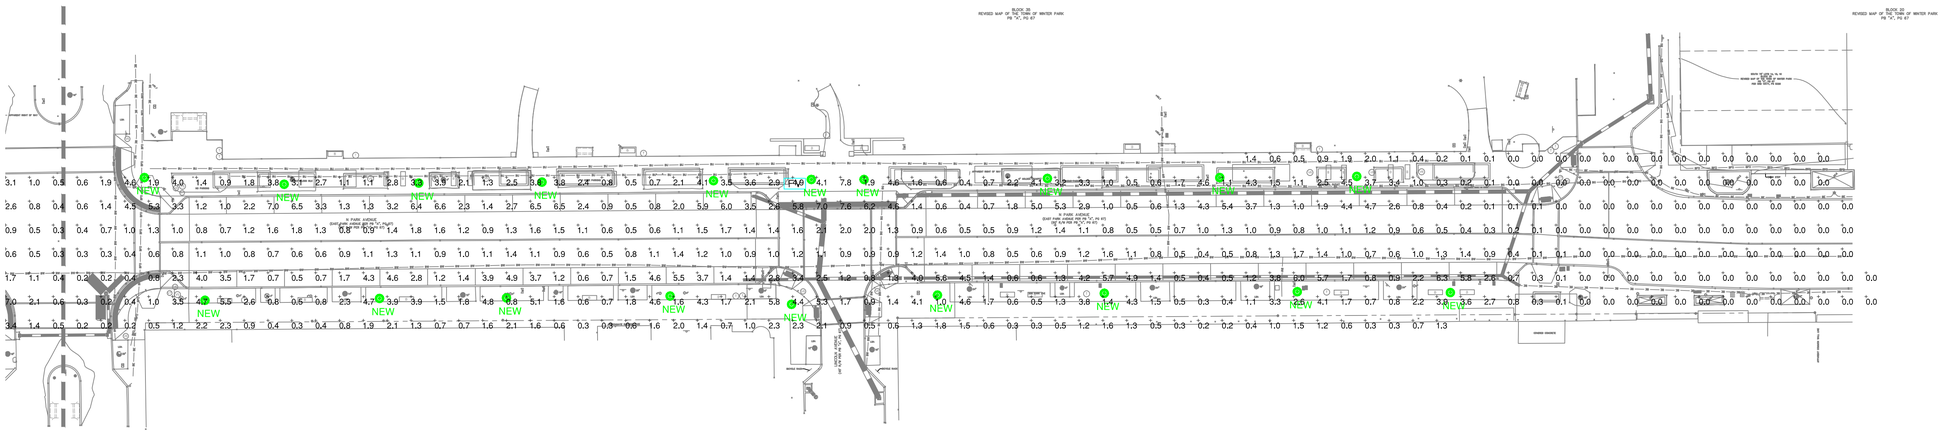

PARTIAL PHOTOMETRIC SITE PLAN

SCALE: 1" = 30'-0" 25080-E-SITE2

GRAPHIC SCALE

30 0 15 30 60

(IN FEET)
1 inch = 30 ft.

MATCHLINE
MATCHLINE

Filename: X:\25080\01-Phase2\25080-E-SITE2.dwg Plotted by: HARRY 10/27/26 12:52

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999

PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2

WINTER PARK, FLORIDA

PARTIAL PHOTOMETRIC SITE PLAN

MICHAEL L DODANE
LICENSE
No. 44665
STATE OF FLORIDA
PROFESSIONAL ENGINEER

PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	1" = 30'-0"
FILENAME:	25080-E-SITE2


E-1

To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.

Landreth Lighting Luminaire Schedule


Symbol	[MANUFAC]	Qty	Label	Arrangement	Description	LLF	Lum. Watts	Lum. Lumens	BUG Rating
⊙	Sternberg Lighting	37	NEW	Single	SSP20777-PT-E350LED-UF-18L27T3-MDLD18-SV2-RTB213FP6-250-EB-1.0-GF1-LPIUC-WHI-DBA-CSTM-2-PA47BPM-DIS-LPIUC-CL/TT	0.900	32.7	5485	B2-U0-G1

MATCHLINE
MATCHLINE

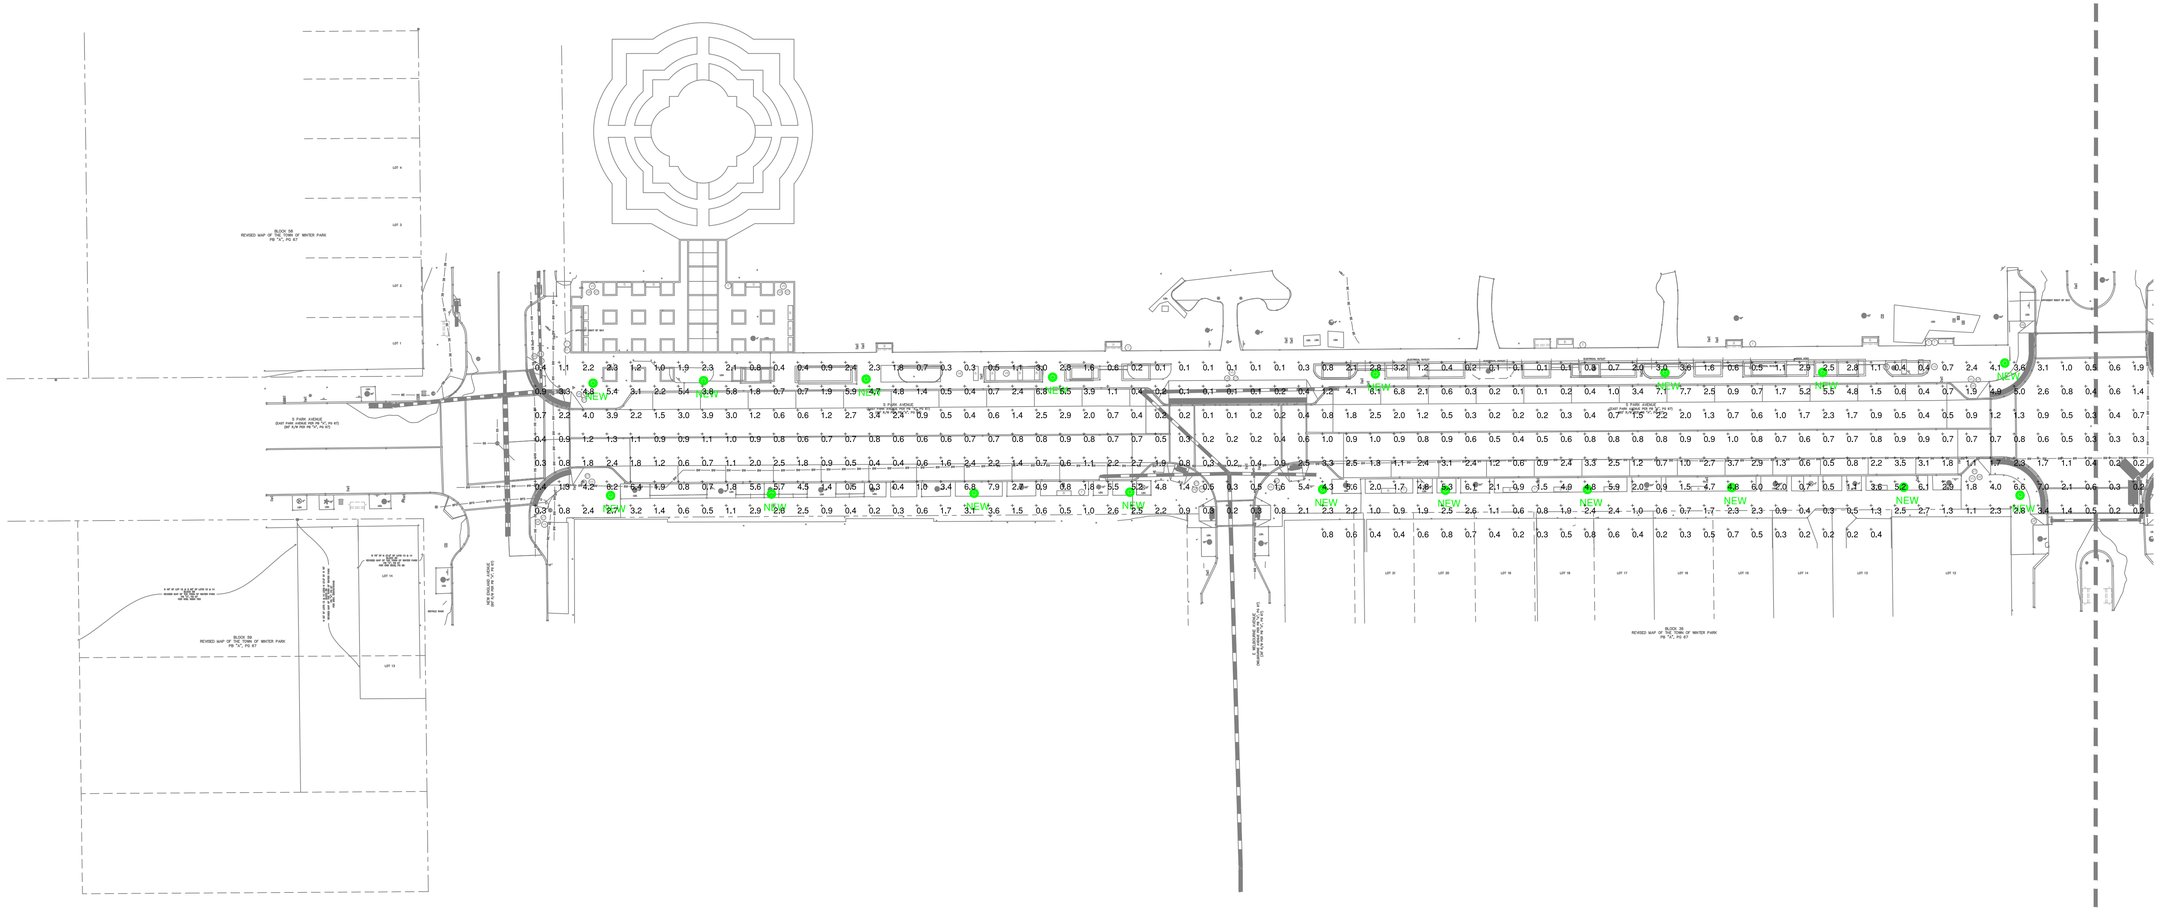

PARTIAL PHOTOMETRIC SITE PLAN

SCALE: 1" = 30'-0" 25080-E-SITE2



GRAPHIC SCALE

30 0 15 30 60

(IN FEET)
1 inch = 30 ft.

MATCHLINE
MATCHLINE

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999

PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2

WINTER PARK, FLORIDA

PARTIAL PHOTOMETRIC
SITE PLAN




PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	1" = 30'-0"
FILENAME:	25080-E-SITE2

E-2

To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.

Filename: X:\25080101-Phase2\25080-E-SITE2.dwg Plotted by: HARRY 10/27/26 12:52

MATCHLINE
MATCHLINE

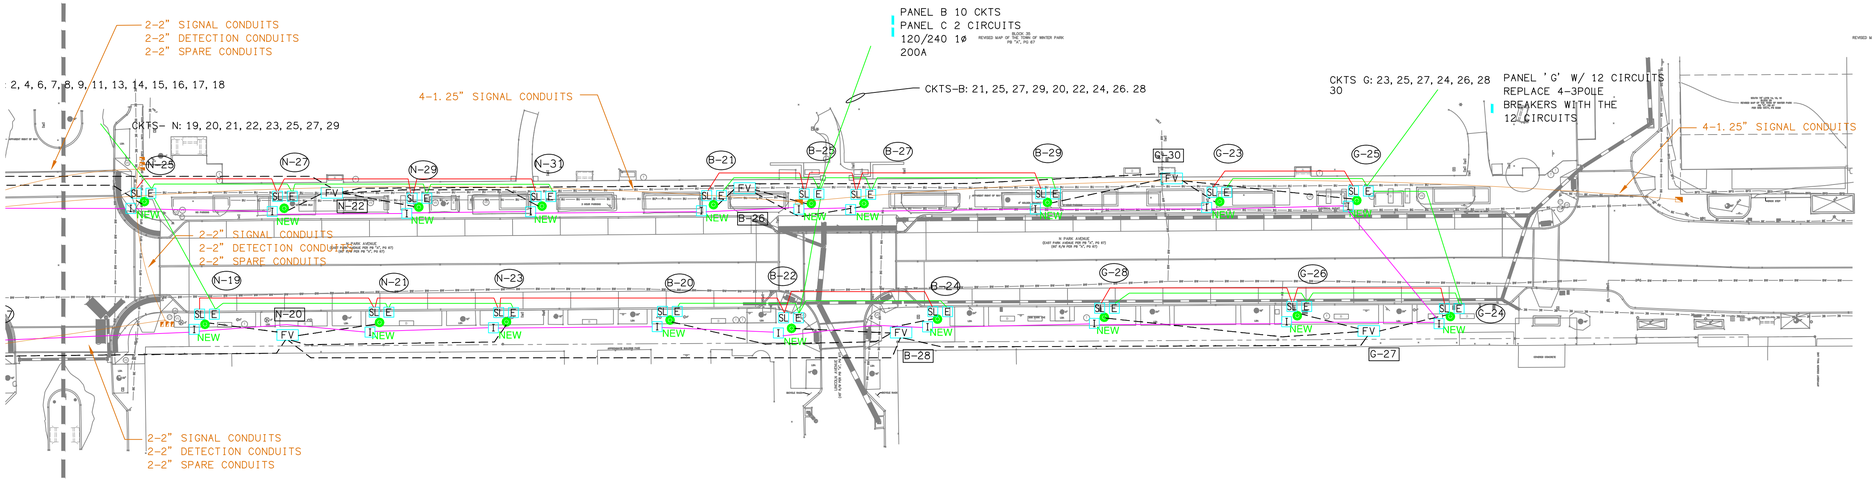

MATCHLINE
MATCHLINE

PARTIAL ELECTRICAL SITE PLAN

SCALE: 1" = 30'-0" 25080-E-SITE2

GRAPHIC SCALE

30 0 15 30 60

(IN FEET)
1 inch = 30 ft.

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999

PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2

WINTER PARK, FLORIDA

PARTIAL ELECTRICAL
SITE PLAN

MICHAEL DODANE
LICENSE
No. 44665
STATE OF FLORIDA
PROFESSIONAL ENGINEER

PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	1" = 30'-0"
FILENAME:	25080-E-SITE2

E-3

To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.


Filename: X:\25080\01-Phase2\25080-E-SITE2.dwg Plotted by: HARRY 10/27/26 12:52

LEGEND

- POLE LIGHT–SEE SCHEDULE SHEET E–1
- 1–2" CONDUIT BETWEEN J–BOXES AS INDICATED
- 2" CONDUIT FOR SITE LIGHTING ROUTE AS INDICATED
- 2" CONDUIT FOR FIBER ROUTE AS INDICATED
- 1–1/4" CONDUIT FOR IRRIGATION– ROUTE AS INDICATED
- FV — FIBER VAULT–VERIFY EXACT SPECIFICATIONS. 3–POLES PER VAULT UNLESS OTHERWISE INDICATED PROVIDE (2)1–1/4" CONDUITS FROM BOX, STUB UP IN BASE OF POLE.
- E — NEW ELECTRICAL BOX 12X12 MOUNT FLUSH WITH FINAL GRADE PROVIDE 1" CONDUIT FROM BOX, STUB UP IN BASE OF POLE.
- SL — NEW SITE LIGHTING J–BOX–12X12 FLUSH MOUNT WITH FINAL GRADE PROVIDE 1" CONDUIT FROM BOX, STUB UP IN BASE OF POLE.
- I — IRRIGATION BOX–VERIFY EXACT STYLE AND MANUFACTURER WITH UTILITIES PROVIDE 1" CONDUIT FROM BOX, STUB UP IN BASE OF POLE.
- CAM — CAMERA
- ACCESS POINT
- SB — TRAFFIC SIGNAL J–BOX–VERIFY EXACT SPECIFICATIONS.
- EXISTING SERVICE PANEL–SEE SCHEDULES
- B–10 — DENOTES RECEPTACLE CIRCUITS: TWIST LOC AT TOP OF POLE AND GRADE LEVEL RECEPTACLE AT BASE OF POLE–1 CIRCUIT PER POLE
- B–40 — DENOTES FIBER EQUIPMENT CIRCUIT

PLAN NOTES

1. POLE LIGHTING CIRCUITRY AND RECEPTACLE CIRCUITRY TO BE ROUTED IN SEPARATE CONDUITS.
2. ALL POLE LIGHTING CIRCUITS IN 1–1/4" CONDUIT.
3. PROVIDE NECESSARY PULL BOXES AS REQUIRED.
4. FINAL CONNECTION FROM PULL BOX TO POLE LIGHT TO BE #12 CU.

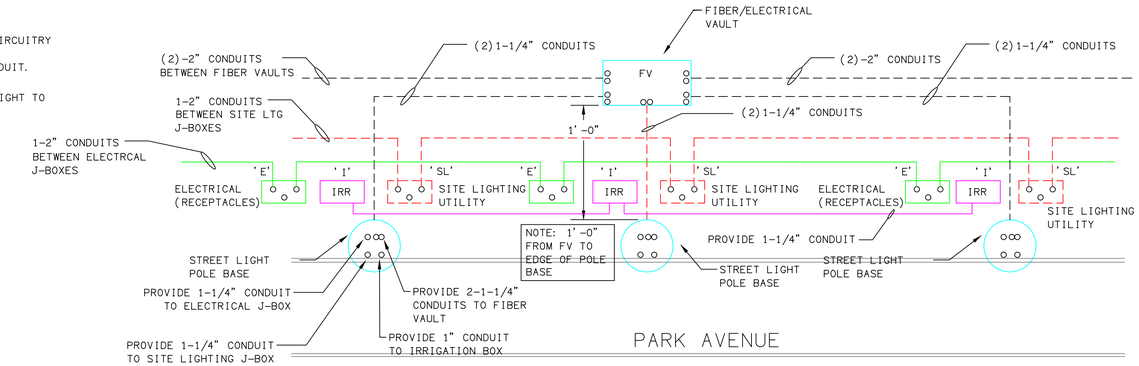


CONDUIT ROUTING DETAIL

NO SCALE


NOTE: PROVIDE MULE TAPE IN ALL CONDUITS.

MATCHLINE MATCHLINE

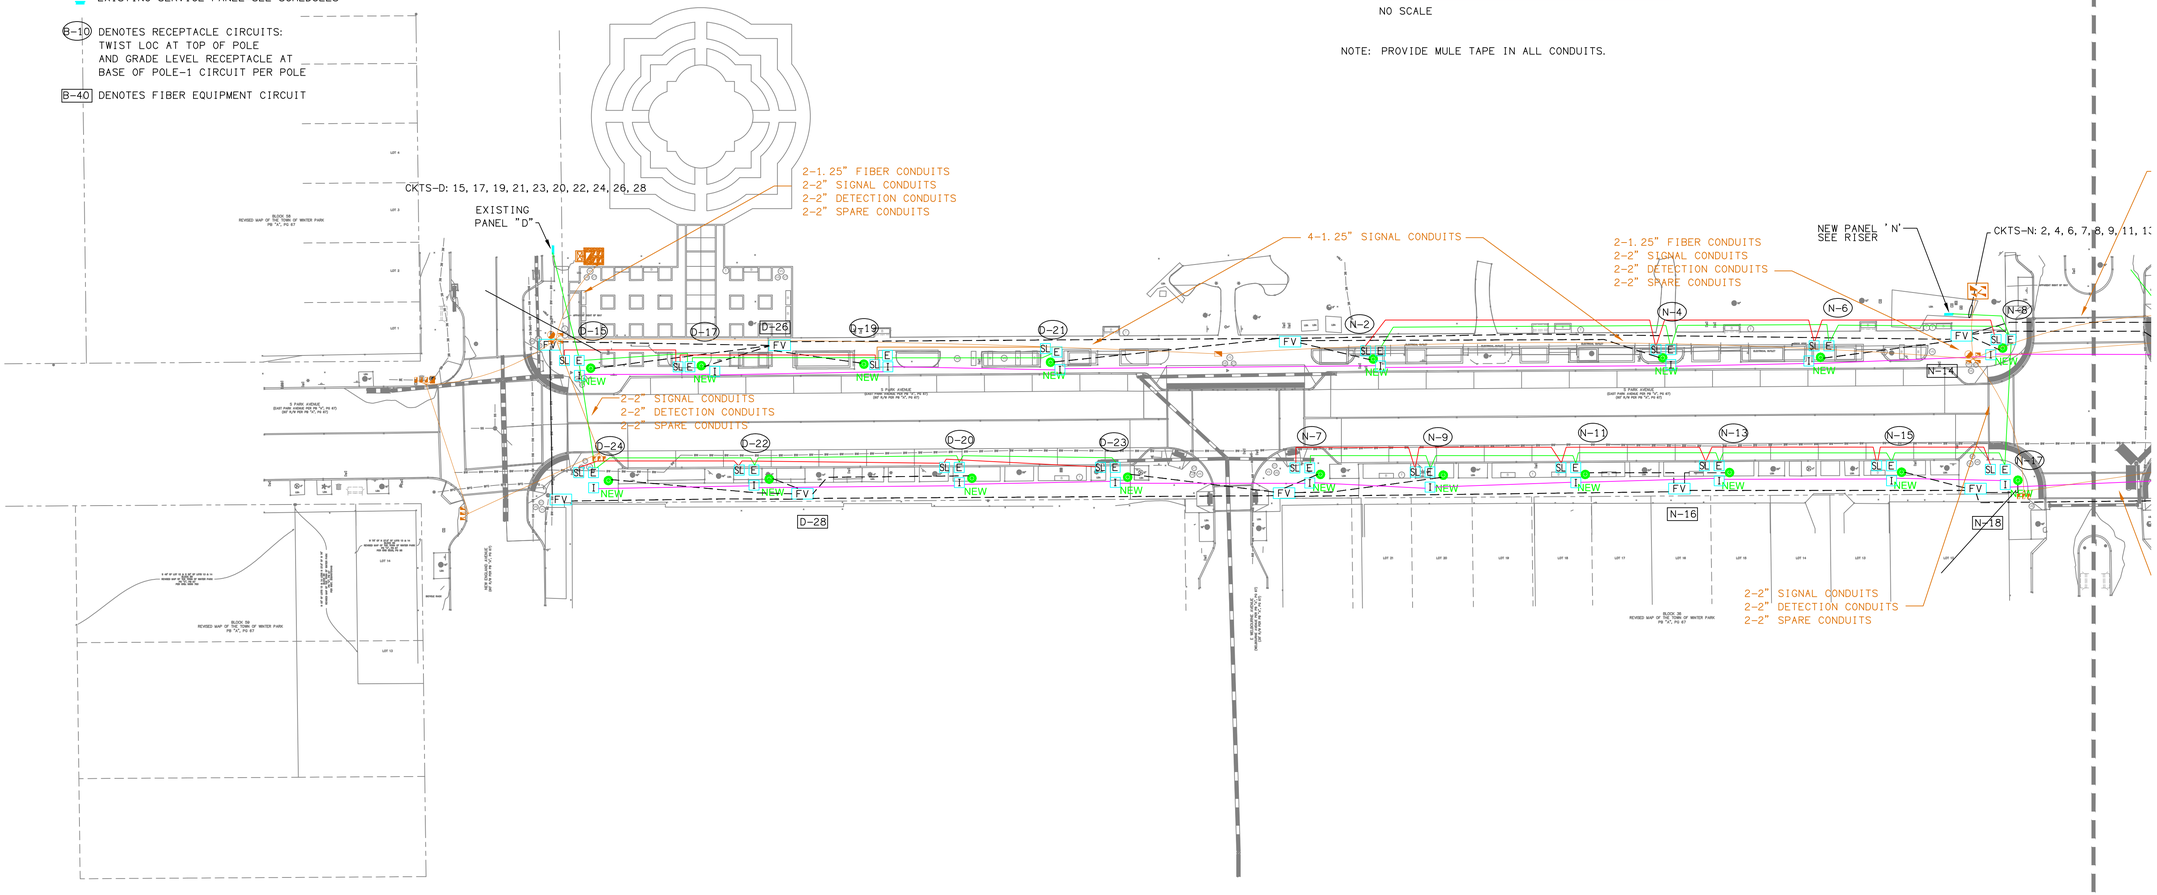

PARTIAL ELECTRICAL SITE PLAN

SCALE: 1" = 30'-0" 25080-E-SITE2



MATCHLINE MATCHLINE

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999
PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2

WINTER PARK, FLORIDA

PARTIAL ELECTRICAL SITE PLAN



PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	1" = 30'-0"
FILENAME:	25080-E-SITE2

E-4

To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.

Filename: X:\25080\01-Phase2\25080-E-SITE2.dwg Plotted by: HARRY 10/27/26 12:52

PANELBOARD SCHEDULE "D"

EXISTING PANEL

200 A. MAIN L. O. — 240/120 VOLTS
SURFACE MOUNTING — NEMA 3R — 1 PHASE — 3 WIRE, 60 HZ.
22 K A. I. C. MINIMUM INTERRUPTING RATING

LOAD KVA	SERVES	TRIP AMPS	POLES	WIRE	GND	SPACE NO.	GND	WIRE	POLES	TRIP AMPS	SERVES	LOAD KVA
0. 60	EXISTING CKTS	20	1	–	–	1	2	–	–	1	20	EXISTING CKTS	–
0. 60	EXISTING CKTS	20	1	–	–	3	4	–	–	1	20	EXISTING CKTS	–
1. 20	EXISTING CKTS	20	1	–	–	5	6	–	–	1	20	EXISTING CKTS	0. 60
1. 20	EXISTING CKTS	20	1	–	–	7	8	–	–	1	20	EXISTING CKTS	0. 60
1. 20	EXISTING CKTS	20	1	–	–	9	10	–	–	1	20	EXISTING CKTS	1. 20
0. 60	EXISTING CKTS	20	1	–	–	11	12	–	–	1	20	EXISTING CKTS	1. 20
0. 60	EXISTING CKTS	20	1	–	–	13	14	–	–	1	20	EXISTING CKTS	0. 60
0. 90	TWIST LOC/GRADE REC	20	1	12	12	15	16	–	–	1	20	EXISTING CKTS	–
0. 90	TWIST LOC/GRADE REC	20	1	12	12	17	18	–	–	1	20	EXISTING CKTS	–
0. 90	TWIST LOC/GRADE REC	20	1	10	10	19	20	10	8	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	8	10	21	22	10	10	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	8	10	23	24	12	12	1	20	TWIST LOC/GRADE REC	0. 90
–	–	–	–	–	–	25	26	12	12	1	20	FIBER EQUIP	0. 75
–	–	–	–	–	–	27	28	12	12	1	20	FIBER EQUIP	0. 75
–	–	–	–	–	–	29	30	–	–	–	–	–	–
–	–	–	–	–	–	31	32	–	–	–	–	–	–
–	–	–	–	–	–	33	34	–	–	–	–	–	–
–	–	–	–	–	–	35	36	–	–	–	–	–	–
–	–	–	–	–	–	37	38	–	–	–	–	–	–
–	–	–	–	–	–	39	40	–	–	–	–	–	–
–	–	–	–	–	–	41	42	–	–	–	–	–	–

LOAD DESCRIPTION	CONN. LOAD	D. F.	CALC. LOAD	NOTES:
LIGHTING – KVA	0. 00	1. 25	0. 00	
RECEPTACLES – 1ST 10 KVA	10. 00	1. 00	10. 00	
RECEPTACLES – ABOVE 10 KVA	3. 80	0. 50	1. 90	
MOTORS – KVA	0. 00	1. 00	0. 00	
EQUIPMENT – KVA	0. 00	1. 00	0. 00	
OTHER – KVA	0. 00	1. 00	0. 00	
TOTAL – KVA	13. 80		11. 90	

PANELBOARD SCHEDULE "B"

EXISTING PANEL

200 A. MAIN L. O. — 240/120 VOLTS
SURFACE MOUNTING — NEMA 3R — 1 PHASE — 3 WIRE, 60 HZ.
22 K A. I. C. MINIMUM INTERRUPTING RATING

LOAD KVA	SERVES	TRIP AMPS	POLES	WIRE	GND	SPACE NO.	GND	WIRE	POLES	TRIP AMPS	SERVES	LOAD KVA
0. 60	EXISTING CIRCUITS	20	1	–	–	1	2	–	–	2	20	EXISTING CIRCUITS	–
0. 60	EXISTING CIRCUITS	20	1	–	–	3	4	–	–	–	–	–	–
1. 20	EXISTING CIRCUITS	20	1	–	–	5	6	–	–	2	20	EXISTING CIRCUITS	0. 60
1. 20	EXISTING CIRCUITS	20	1	–	–	7	8	–	–	–	–	–	0. 60
1. 20	EXISTING CIRCUITS	20	1	–	–	9	10	–	–	2	20	EXISTING CIRCUITS	1. 20
0. 60	EXISTING CIRCUITS	20	1	–	–	11	12	–	–	–	–	–	1. 20
0. 60	EXISTING CIRCUITS	20	1	–	–	13	14	–	–	1	20	EXISTING CIRCUITS	0. 60
1. 20	EXISTING CIRCUITS	20	1	–	–	15	16	–	–	1	20	EXISTING CIRCUITS	–
1. 20	EXISTING CIRCUITS	20	1	–	–	17	18	–	–	1	20	EXISTING CIRCUITS	–
1. 20	EXISTING CIRCUITS	20	1	–	–	19	20	10	10	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	10	10	21	22	10	10	1	20	TWIST LOC/GRADE REC	0. 90
–	EXISTING CIRCUITS	20	1	–	–	23	24	10	10	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	10	10	25	26	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	10	10	27	28	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	10	10	29	30	–	–	–	–	–	–
–	–	–	–	–	–	31	32	–	–	–	–	–	–
–	–	–	–	–	–	33	34	–	–	–	–	–	–
–	–	–	–	–	–	35	36	–	–	–	–	–	–
–	–	–	–	–	–	37	38	–	–	–	–	–	–
–	–	–	–	–	–	39	40	–	–	–	–	–	–
–	–	–	–	–	–	41	42	–	–	–	–	–	–

LOAD DESCRIPTION	CONN. LOAD	D. F.	CALC. LOAD	NOTES:
LIGHTING – KVA	0. 00	1. 25	0. 00	
RECEPTACLES – 1ST 10 KVA	10. 00	1. 00	10. 00	
RECEPTACLES – ABOVE 10 KVA	3. 80	0. 50	1. 90	
MOTORS – KVA	0. 00	1. 00	0. 00	
EQUIPMENT – KVA	0. 00	1. 00	0. 00	
OTHER – KVA	0. 00	1. 00	0. 00	
TOTAL – KVA	13. 80		11. 90	

PANELBOARD SCHEDULE "N"

NEW PANEL

200 A. MAIN C. B. — 240/120 VOLTS
SURFACE MOUNTING — NEMA 3R — 1 PHASE — 3 WIRE, 60 HZ.
22 K A. I. C. MINIMUM INTERRUPTING RATING

LOAD KVA	SERVES	TRIP AMPS	POLES	WIRE	GND	SPACE NO.	GND	WIRE	POLES	TRIP AMPS	SERVES	LOAD KVA
–	–	–	–	–	–	1	2	10	8	1	20	TWIST LOC/GRADE REC	0. 90
–	–	–	–	–	–	3	4	12	12	1	20	TWIST LOC/GRADE REC	0. 90
–	–	–	–	–	–	5	6	12	12	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	8	10	7	8	12	12	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	8	10	9	10	–	–	–	–	–	–
0. 90	TWIST LOC/GRADE REC	20	1	8	10	11	12	–	–	–	–	–	–
0. 90	TWIST LOC/GRADE REC	20	1	10	10	13	14	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	12	12	15	16	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	12	12	17	18	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	10	10	19	20	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	8	10	21	22	12	12	1	20	FIBER EQUIP	0. 75
0. 90	TWIST LOC/GRADE REC	20	1	8	10	23	24	–	–	–	–	–	–
0. 90	TWIST LOC/GRADE REC	20	1	8	10	25	26	–	–	–	–	–	–
0. 90	TWIST LOC/GRADE REC	20	1	8	10	27	28	–	–	–	–	–	–
0. 90	TWIST LOC/GRADE REC	20	1	8	10	29	30	–	–	–	–	–	–
0. 90	TWIST LOC/GRADE REC	20	1	8	10	31	32	–	–	–	–	–	–
–	–	–	–	–	–	33	34	–	–	–	–	–	–
–	–	–	–	–	–	35	36	–	–	–	–	–	–
–	–	–	–	–	–	37	38	–	–	–	–	–	–
–	–	–	–	–	–	39	40	–	–	–	–	–	–
–	–	–	–	–	–	41	42	–	–	–	–	–	–

LOAD DESCRIPTION	CONN. LOAD	D. F.	CALC. LOAD	NOTES:
LIGHTING – KVA	0. 00	1. 25	0. 00	
RECEPTACLES – 1ST 10 KVA	10. 00	1. 00	10. 00	
RECEPTACLES – ABOVE 10 KVA	8. 15	0. 50	4. 08	
MOTORS – KVA	0. 00	1. 00	0. 00	
EQUIPMENT – KVA	3. 00	1. 00	3. 00	
OTHER – KVA	0. 00	1. 00	0. 00	
TOTAL – KVA	21. 15		17. 08	


PANELBOARD SCHEDULE "G"

EXISTING PANEL

200 A. MAIN L. O. — 208/120 VOLTS
SURFACE MOUNTING — NEMA 3R — 3 PHASE — 4 WIRE, 60 HZ.
22 K A. I. C. MINIMUM INTERRUPTING RATING

LOAD KVA	SERVES	TRIP AMPS	POLES	WIRE	GND	SPACE NO.	GND	WIRE	POLES	TRIP AMPS	SERVES	LOAD KVA
0. 60	EXISTING CIRCUITS	20	3	–	–	1	2	–	–	3	20	EXISTING CIRCUITS	–
0. 60	–	–	–	–	–	3	4	–	–	–	–	–	–
1. 20	–	–	–	–	–	5	6	–	–	–	–	–	0. 60
1. 20	EXISTING CIRCUITS	20	3	–	–	7	8	–	–	3	20	EXISTING CIRCUITS	0. 60
1. 20	–	–	–	–	–	9	10	–	–	–	–	–	1. 20
0. 60	–	–	–	–	–	11	12	–	–	–	–	–	1. 20
0. 60	EXISTING CIRCUITS	20	1	–	–	13	14	–	–	1	20	EXISTING CIRCUITS	0. 60
1. 20	EXISTING CIRCUITS	20	1	–	–	15	16	–	–	1	20	EXISTING CIRCUITS	–
1. 20	EXISTING CIRCUITS	20	1	–	–	17	18	–	–	1	20	EXISTING CIRCUITS	–
1. 20	EXISTING CIRCUITS	20	1	–	–	19	20	–	–	1	20	EXISTING CIRCUITS	–
0. 15	EXISTING CIRCUITS	20	1	–	–	21	22	–	–	1	20	EXISTING CIRCUITS	–
0. 90	TWIST LOC/GRADE REC	20	1	10	10	23	24	10	10	1	20	TWIST LOC/GRADE REC	0. 90
0. 90	TWIST LOC/GRADE REC	20	1	10	10	25	26	10	10	1	20	TWIST LOC/GRADE REC	0. 90
0. 75	FIBER EQUIP	20	1	12	12	27	28	10	10	1	20	TWIST LOC/GRADE REC	0. 90
–	–	–	–	–	–	29	30	12	12	1	20	FIBER EQUIP	0. 75
–	–	–	–	–	–	31	32	–	–	–	–	–	–
–	–	–	–	–	–	33	34	–	–	–	–	–	–
–	–	–	–	–	–	35	36	–	–	–	–	–	–
–	–	–	–	–	–	37	38	–	–	–	–	–	–
–	–	–	–	–	–	39	40	–	–	–	–	–	–
–	–	–	–	–	–	41	42	–	–	–	–	–	–

LOAD DESCRIPTION	CONN. LOAD	D. F.	CALC. LOAD	NOTES:
LIGHTING – KVA	0. 00	1. 25	0. 00	NOTE: CIRCUITS 20 THRU 28 CURRENTLY OCCUPIED BY 3P BREAKERS–REMOVE BREAKERS AND REPLACE WITH BREAKERS INDICATED.
RECEPTACLES – 1ST 10 KVA	10. 00	1. 00	10. 00	
RECEPTACLES – ABOVE 10 KVA	8. 30	0. 50	4. 15	
MOTORS – KVA	0. 00	1. 00	0. 00	
EQUIPMENT – KVA	1. 65	1. 00	1. 65	
OTHER – KVA	0. 00	1. 00	0. 00	
TOTAL – KVA	19. 95		15. 80	

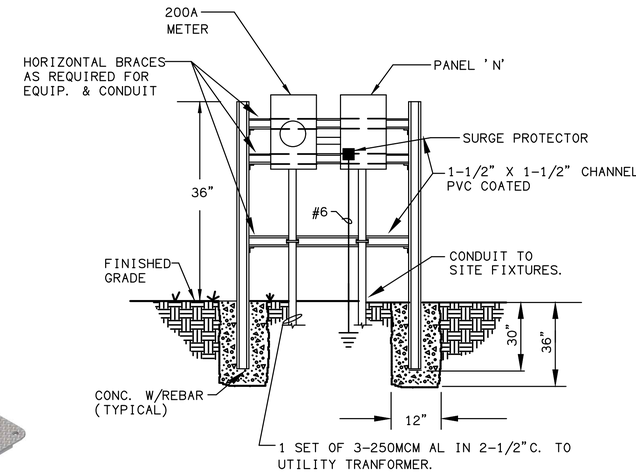

SITE LIGHTING STATION
NOT TO SCALE

2436

OLDCASTLE POLYMER

(formerly H-Series)

COVER

Style: Flush Solid
Material: Polymer Concrete
Model: 24" x 36"
Weight: Tier 15: 150 lbs.
Tier 22: 204 lbs.
Std. Fasteners: 1/2-13 Stainless Steel Hex Head Bolt, Washer and Floating Nut
Options: Logos and Special Markings
Surface: Slip Resistant
Performance: ANSI/SCTE-77, Tier 15 or Tier 22*

Cover comes standard with permanent markings for manufacturer, load rating, model size and manufacturing location.


BODY

Material: Polymer Concrete
Model: 24" x 36"
Weight: 18" Depth: 142 lbs.
24" Depth: 175 lbs.
36" Depth: 242 lbs.
Wall Type: Straight
Performance: ANSI/SCTE-77 Tier 22

LOAD RATING / NOTES

MEDIUM DUTY ANSI/SCTE TIER 15
HEAVY DUTY ANSI/SCTE TIER 22

For use in non-vehicular traffic situations only. Weights and dimensions may vary slightly. Actual load rating is determined by the box and cover combination.



	A	B	C	D	E
2436-18	18	23-5/8	35-1/4	33-3/15	21-9/16
2436-24	24	23-3/8	34-15/16	32-13/16	21-5/16
2436-30	30	23-1/2	35-1/8	32-3/4	21-1/8
2436-36	36	23-3/16	34-11/16	32-7/16	20-15/16

* Based upon lid and body combination, this unit can be Tier 15 or Tier 22. T22 rating when paired with T22 polymer concrete lid.

Oldcastle Infrastructure
oldcastleenclosures.com
(800) 735-5566


2436

OLDCASTLE POLYMER

(formerly H-Series)


COVER OPTIONS

Oldcastle Polymer, Flush Solid
Oldcastle Polymer, Flush 2-Piece
Oldcastle Polymer, Flush Pedestal Provision
Steel, Solid



FASTENER OPTIONS

Hex Head Bolt (A)
Penta Head Bolt (B)
Penta Head Coil Thread Bolt (B)
Oldcastle Vandal Resistant Bolt (C)
Captive Bolt Retainer



ADD ON OPTIONS

EMS Marker
Mouseholes/Knockouts
Rack Mount
Cable Racks/Cable Arms
Unistrut
Pulling Eye - 1,000 lb and 3,000 lb
Ground Buss
Dividers
Racking Provision
Lid Gaskets*
Solid Bottom
Custom Marking Plate (Polymer)



* Lid Gaskets inhibit water flow into the box, they do not make enclosure fully waterproof.

⚠ **WARNING:** Cancer - www.P65Warnings.ca.gov

All information contained on this sheet is current at the time of publication. Oldcastle reserves the right to discontinue or update product information without notice.

Revision 11/09/18
© 2018 Oldcastle Infrastructure.

Oldcastle Infrastructure
oldcastleenclosures.com
(800) 735-5566

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999

PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2

WINTER PARK, FLORIDA

ELECTRICAL
SCHEDULES AND DETAILS




PROJECT NO: 25080
DRAWN BY: MLD
CHECKED BY: MLD
APPROVED BY: MLD
DATE: 03/13/26
SCALE: AS INDICATED
FILENAME 25080-E-SCHEDS2

E-5

To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.

Filename: C:\Users\harry\appdata\local\temp\AcPublish_30420\25080-E-SCHEDS2.dwg Plotted by: HARRY 10/27/26 12:52

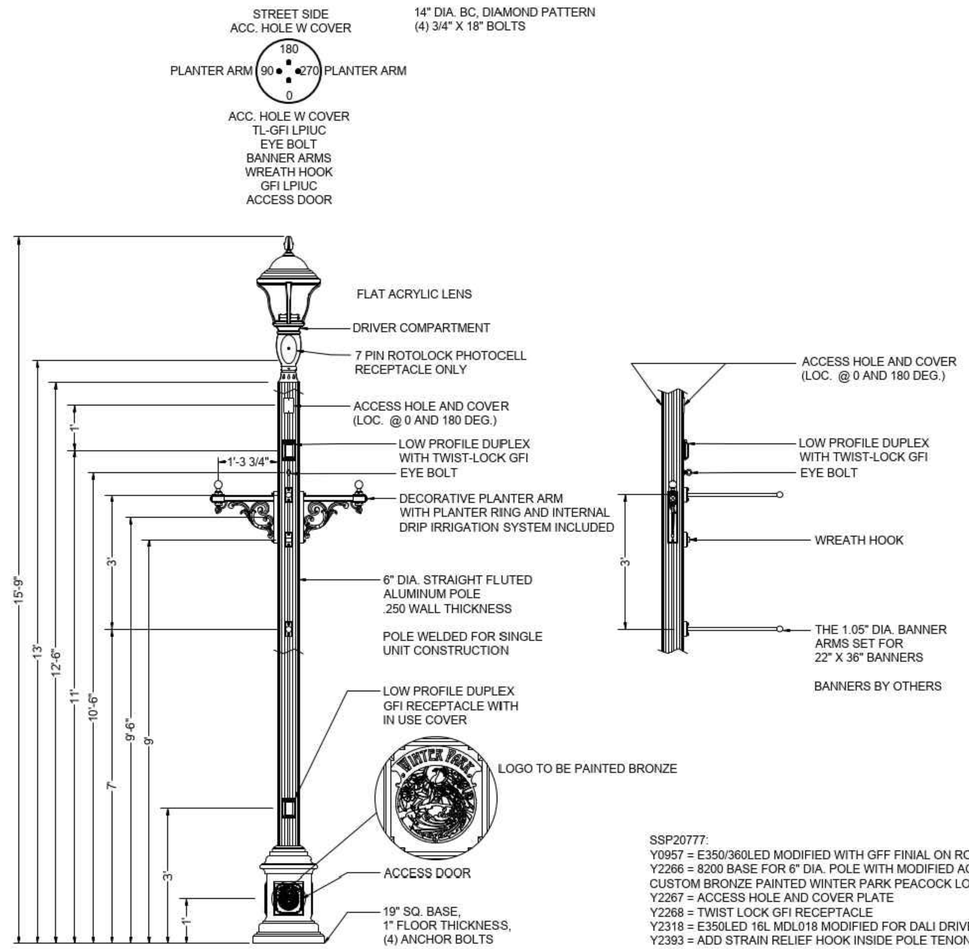


SSP20777:
Y0957 = E350/360LED MODIFIED WITH GFF FINIAL ON ROOF
Y2266 = 8200 BASE FOR 6" DIA. POLE WITH MODIFIED ACCESS DOOR TO MOUNT CUSTOM BRONZE PAINTED WINTER PARK PEACOCK LOGO USING TAMPER PROOF SCREWS
Y2267 = ACCESS HOLE AND COVER PLATE
Y2268 = TWIST LOCK GFI RECEPTACLE
Y2318 = E350LED 16L MDL018 MODIFIED FOR DALI DRIVER AND RF CONTROL
Y2393 = ADD STRAIN RELIEF HOOK INSIDE POLE TENON

C	Y2393 ADDED TO SSP, BANNER ARM LENGTH UPDATED	7/1/25	EH
B	UPDATED Y2266, CHANGED FINISH TO TT	6/6/25	MFR
A	ORIGINAL	6/5/25	
REV	REVISIONS	DATE	RVSD


TOLERANCES POLE : +/- 2" BANNER ARM SPACING : +/- 0.25" MOUNTING HT. FOR POLE ACCESSORIES : +/- 0.5"

DATE: 7/1/25	DRAWN: EH	CHECKED: -	CATALOG No: SSP20777-PT-E350LED-UF-16L30T3-MDL018-FL-R7/8213FP6-.250-EB-1.0-GFI LPIUC-WHK-DBA-CSTM-2-PA478PM-DIS-LPIUC-CL/TT
DRAWING NO: SC52238		REVISION: C	
Sternberg		JOB NAME: WINTER PARK, FL	LOCATION: WINTER PARK, FL

FIXTURE TYPE 'P1'

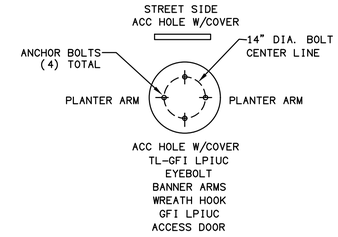

POLE BASE DETAIL- TOP VIEW

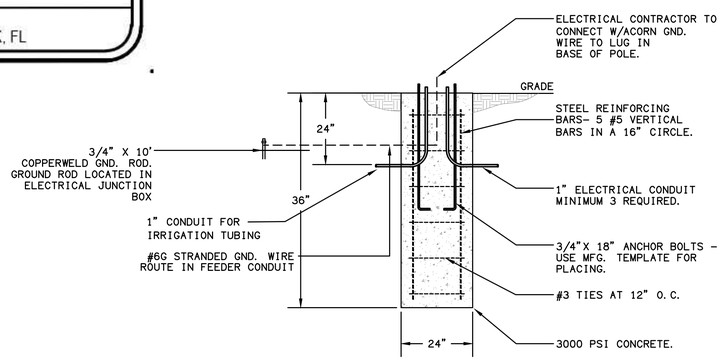

POLE BASE DETAIL SIDE VIEW

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999

PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2
WINTER PARK, FLORIDA
ELECTRICAL
SCHEDULES AND DETAILS


To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.



PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	AS INDICATED
FILENAME	25080-E-SCHEDS2

E-6

Filename: C:\Users\harry\appdata\local\temp\AcPublish_30420\25080-E-SCHEDS2.dwg Plotted by: HARRY 10/27/26 12:52

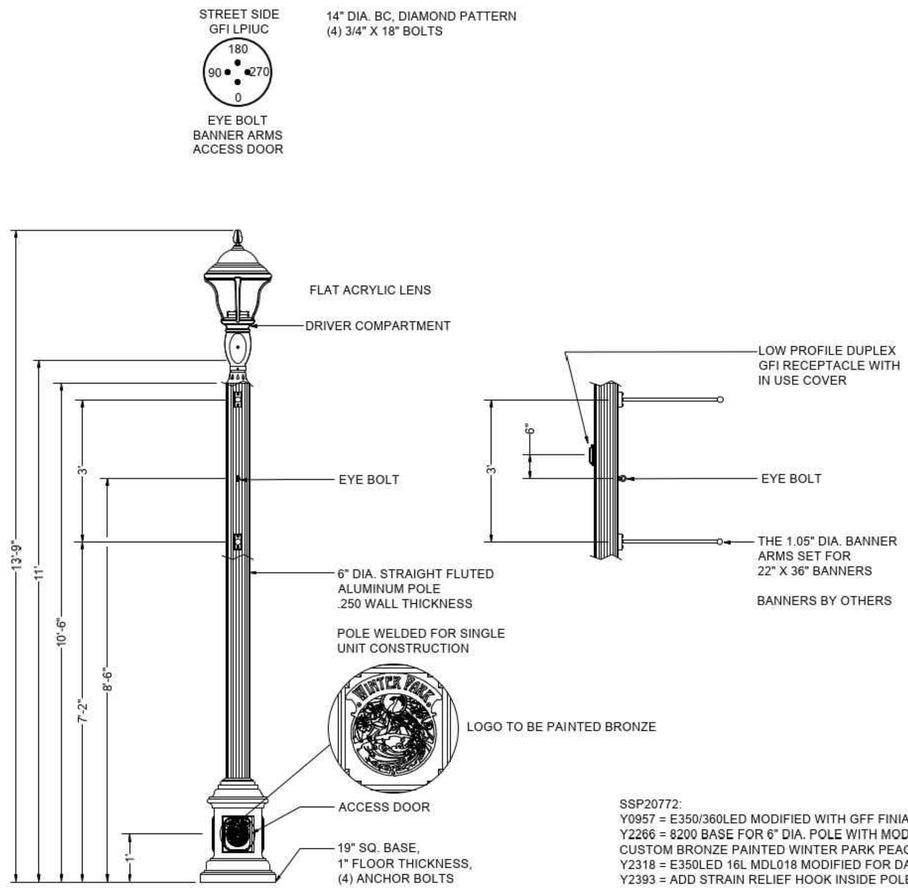

SSP20772:
Y0957 = E350/360LED MODIFIED WITH GFF FINIAL ON ROOF
Y2266 = 8200 BASE FOR 6" DIA. POLE WITH MODIFIED ACCESS DOOR TO MOUNT
CUSTOM BRONZE PAINTED WINTER PARK PEACOCK LOGO USING TAMPER PROOF SCREWS
Y2318 = E350LED 16L MDL018 MODIFIED FOR DALI DRIVER AND RF CONTROL
Y2393 = ADD STRAIN RELIEF HOOK INSIDE POLE TENON

D	Y2393 ADDED TO SSP, BANNER ARM LENGTH UPDATED	7/1/25	EH
B	UPDATED Y2266, CHANGED FINISH TO TT	6/6/25	MFR
A	ORIGINAL	6/5/25	
REV	REVISIONS	DATE	RVSD

TOLERANCES POLE : +/- 2" BANNER ARM SPACING : +/- 0.25" MOUNTING HT. FOR POLE ACCESSORIES : +/- 0.5"

DATE: 7/1/25	DRAWN: EH	CHECKED: -	CATALOG No: SSP20772-PT-E350LED-UF-16L30T3-MDL018-FL-R7/8211FP6-.250-EB-1.0-GFI LPIUC-DBA-CSTM-CL/TT
DRAWING NO: SC52239		REVISION: D	
Sternberg		JOB NAME: WINTER PARK, FL	LOCATION: WINTER PARK, FL

FIXTURE TYPE 'P2'

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999

PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2
WINTER PARK, FLORIDA

ELECTRICAL
SCHEDULES AND DETAILS

MICHAEL L DODANE LICENSE No. 44665 STATE OF FLORIDA PROFESSIONAL ENGINEER

PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	AS INDICATED
FILENAME	25080-E-SCHEDS2

E-7

To the best of the engineers knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.

Filename: C:\Users\harry\appdata\local\temp\AcPublish_30420\25080-E-SCHEDS2.dwg Plotted by: HARRY 10/27/26 12:52