
LEGEND

- POLE LIGHT–SEE SCHEDULE SHEET E–1
- 1–2" CONDUIT BETWEEN J–BOXES AS INDICATED
- 2" CONDUIT FOR SITE LIGHTING ROUTE AS INDICATED
- 2" CONDUIT FOR FIBER ROUTE AS INDICATED
- 1–1/4" CONDUIT FOR IRRIGATION– ROUTE AS INDICATED
- FV — FIBER VAULT–VERIFY EXACT SPECIFICATIONS. 3–POLES PER VAULT UNLESS OTHERWISE INDICATED PROVIDE (2)1–1/4" CONDUITS FROM BOX, STUB UP IN BASE OF POLE.
- E — NEW ELECTRICAL BOX 12X12 MOUNT FLUSH WITH FINAL GRADE PROVIDE 1" CONDUIT FROM BOX, STUB UP IN BASE OF POLE.
- SL — NEW SITE LIGHTING J–BOX–12X12 FLUSH MOUNT WITH FINAL GRADE PROVIDE 1" CONDUIT FROM BOX, STUB UP IN BASE OF POLE.
- I — IRRIGATION BOX–VERIFY EXACT STYLE AND MANUFACTURER WITH UTILITIES PROVIDE 1" CONDUIT FROM BOX, STUB UP IN BASE OF POLE.
- CAM — CAMERA
- ACCESS POINT
- SB — TRAFFIC SIGNAL J–BOX–VERIFY EXACT SPECIFICATIONS.
- EXISTING SERVICE PANEL–SEE SCHEDULES
- B–10 — DENOTES RECEPTACLE CIRCUITS: TWIST LOC AT TOP OF POLE AND GRADE LEVEL RECEPTACLE AT BASE OF POLE–1 CIRCUIT PER POLE
- B–40 — DENOTES FIBER EQUIPMENT CIRCUIT

PLAN NOTES

1. POLE LIGHTING CIRCUITRY AND RECEPTACLE CIRCUITRY TO BE ROUTED IN SEPARATE CONDUITS.
2. ALL POLE LIGHTING CIRCUITS IN 1–1/4" CONDUIT.
3. PROVIDE NECESSARY PULL BOXES AS REQUIRED.
4. FINAL CONNECTION FROM PULL BOX TO POLE LIGHT TO BE #12 CU.

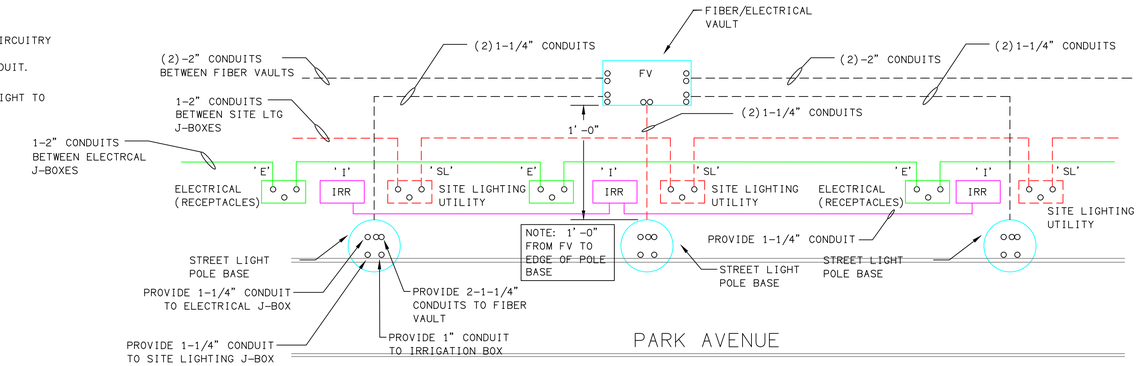


CONDUIT ROUTING DETAIL

NO SCALE


NOTE: PROVIDE MULE TAPE IN ALL CONDUITS.

MATCHLINE MATCHLINE

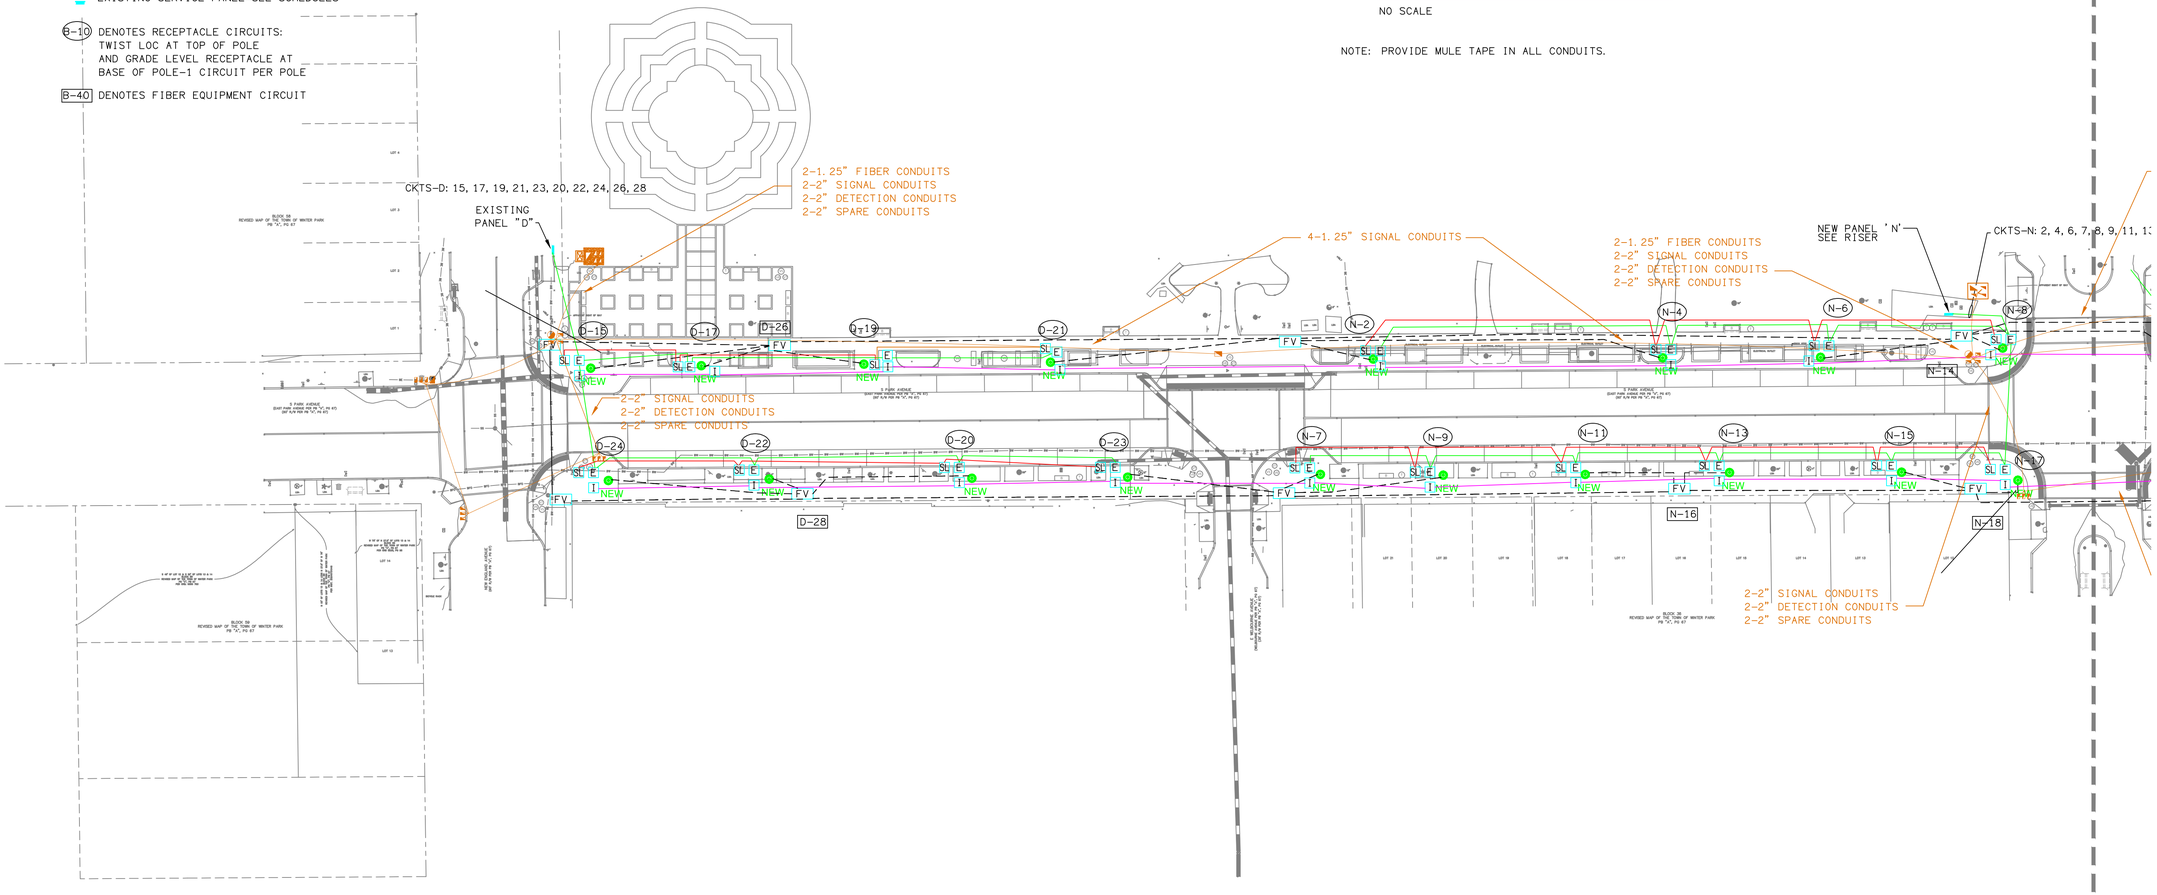

PARTIAL ELECTRICAL SITE PLAN

SCALE: 1" = 30'-0" 25080-E-SITE2



MATCHLINE MATCHLINE

MiGre Engineers LLC
760 FLORIDA CENTRAL PARKWAY
SUITE 224
LONGWOOD, FL 32750
PH: 407.636.7999
PROJECT #: 25080

No.	Date	Revision

Mechanical
Electrical
Plumbing
Fire Protection

PARK AVENUE REFRESH PH2

WINTER PARK, FLORIDA

PARTIAL ELECTRICAL SITE PLAN



PROJECT NO:	25080
DRAWN BY:	MLD
CHECKED BY:	MLD
APPROVED BY:	MLD
DATE:	03/13/26
SCALE:	1" = 30'-0"
FILENAME:	25080-E-SITE2

E-4

To the best of the engineer's knowledge, the plans and specifications comply with the applicable minimum building codes and the applicable fire-safety standards as determined by the local authority in accordance with section 110.8.4.4 of the FBC and 633 Florida Statutes.

Filename: X:\25080\01-Phase2\25080-E-SITE2.dwg Plotted by: HARRY 10/27/26 12:52